



② Sidewalks ≥ 7 ft. (2.13 m) in width should have a buffer which is not part of the P.A.R. The buffer should be 3 ft minimum to keep pedestrians further from traffic and provide a place to install signs.

DEPRESSED CORNER

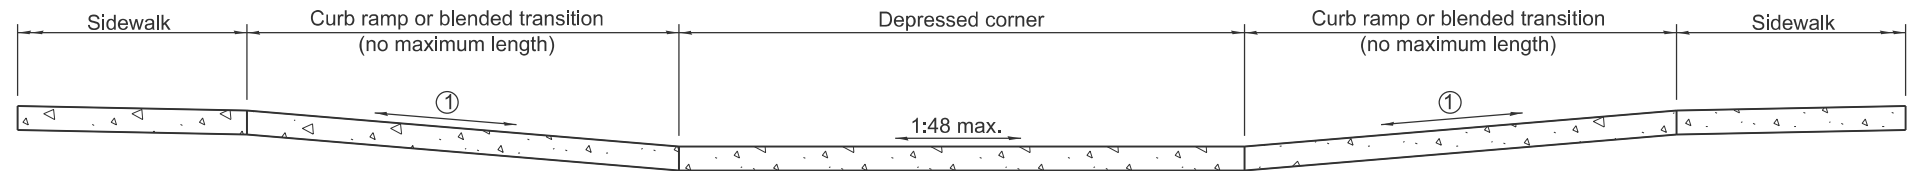


SECTION A-A


① The running slope of a curb ramp shall be 1:12 max. The running slope of a blended transition shall be 1:20 max.

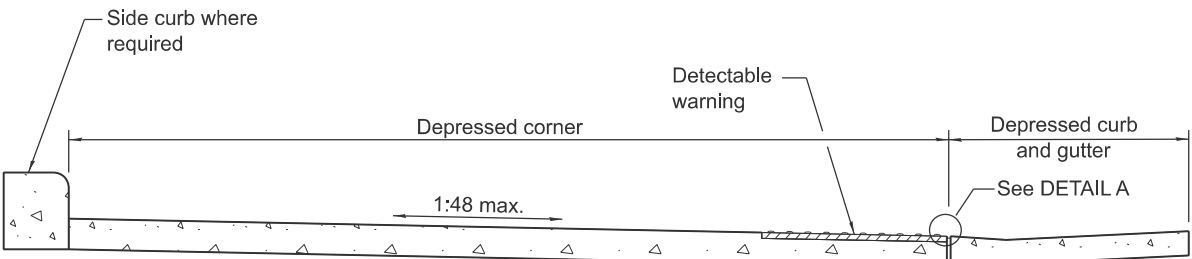

SECTION B-B

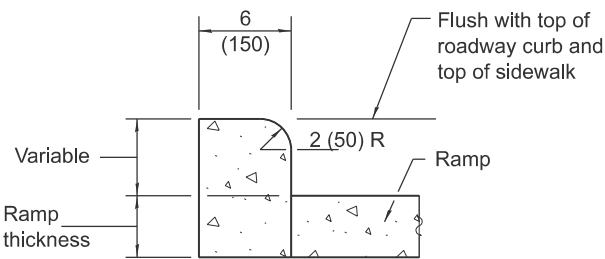

SIDE CURB DETAIL



DETAIL A

GENERAL NOTES

This standard shall only be used for curb radii of 6 ft. (1.83 m) or greater.

All slope ratios are expressed as units of vertical displacement to units of horizontal displacement (V:H).

Where 1:48 maximum slope is shown, 1:64 is preferred.

Detectable warnings are shown in their ideal tolerances but the following placement tolerances are allowed.

Side Border - Detectable warnings should extend the full width of the walking surface (excluding flared sides) but a border along each side up to 2 in. (50 mm) in. width is allowed.

Curb Set-Back - Detectable warnings located at the back of curb should closely align with the curb but a gap up to 6 in. (150 mm) behind the curb is allowed.

See Standard 606001 for details of depressed curb adjacent to curb ramp.

All dimensions are in inches (millimeters) unless otherwise shown.

DATE	REVISIONS
1-1-25	Remove min running slope from note 1 and updated cross-slope.
1-1-21	Added crosswalk striping and a "buffer" for wide sidewalks.

**DEPRESSED CORNER
FOR SIDEWALKS**

STANDARD 424021-07