




**SECTION PARALLEL TO PIPE**  
(Without conical top riser)

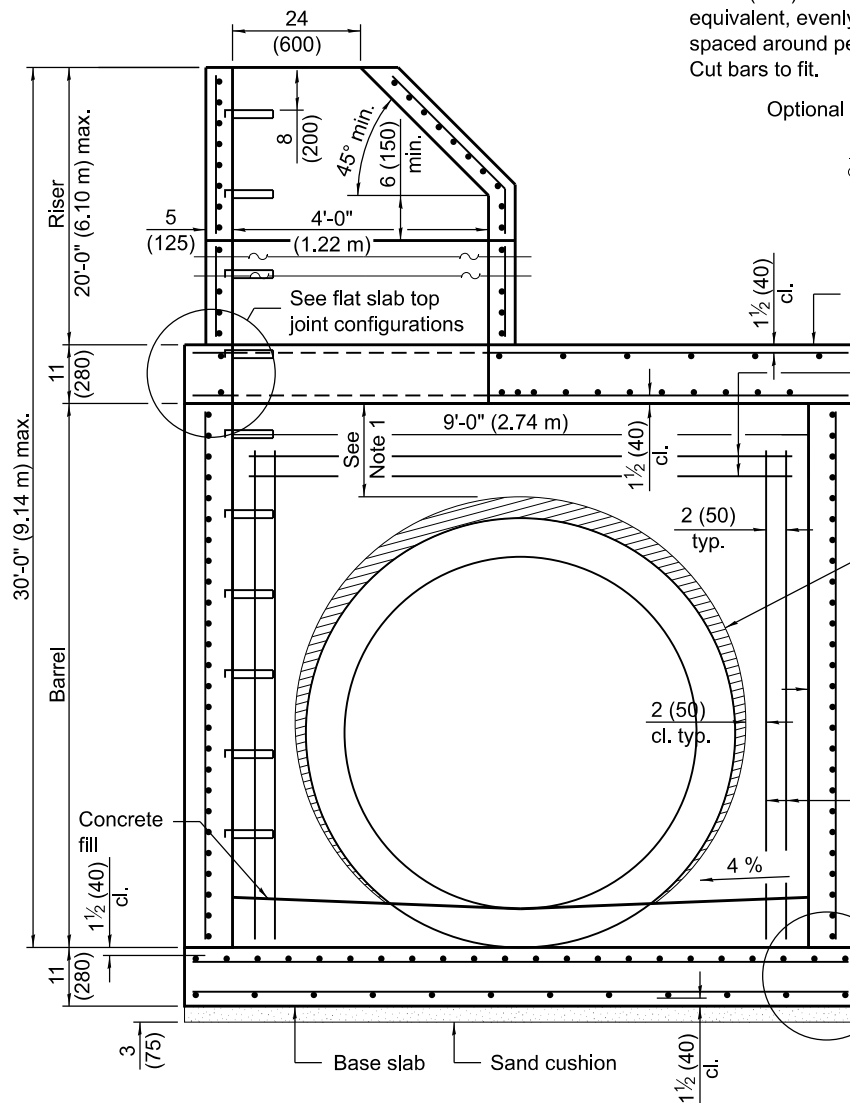

**SECTION PERPENDICULAR TO PIPE**  
(With conical top riser)

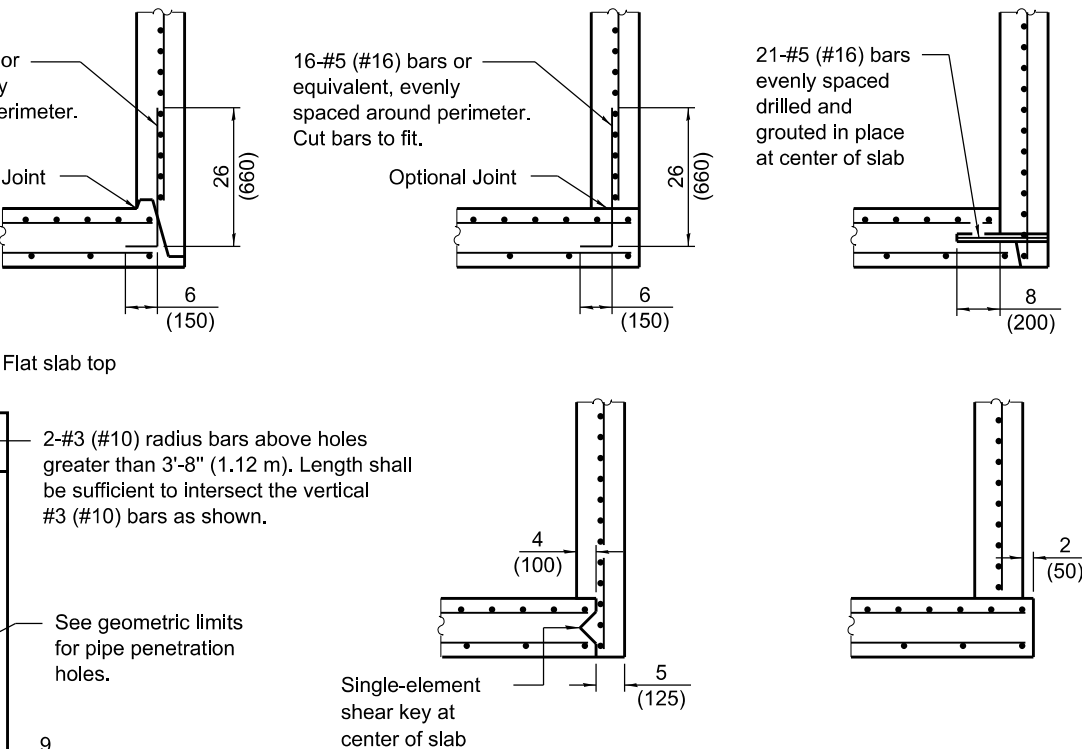


**BASE SLAB JOINT CONFIGURATIONS**

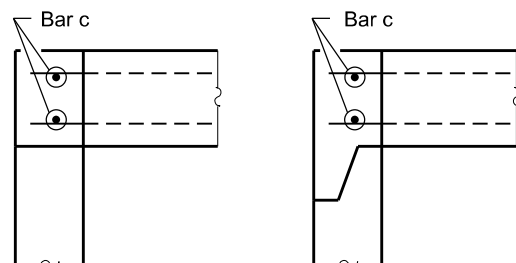

**FLAT SLAB TOP JOINT CONFIGURATIONS**  
(Shown at access hole)

**GEOMETRIC LIMITS FOR PIPE PENETRATION HOLES**

- Note 1: A minimum of 12 (300) of monolithic reinforced concrete shall be maintained above pipe penetration holes > 3'-8" (1.12 m).
- Note 2: A minimum 12 (300) inside arc length of reinforced concrete shall be maintained between pipe penetration holes > 15 (380).
- Note 3: A maximum of 60 percent of the inside perimeter of the reinforced concrete manhole walls may be removed.
- Note 4: Horizontal joints that intersect pipe penetration holes > 15 (380) shall have one joint splice for every location around the perimeter of the joint where the inside arc length between pipe penetration holes is < 24 (600). See joint splice detail.
- Note 5: The recommended pipe penetration hole is equal to the O.D. of the pipe plus 4 (100).
- Note 6: Only pipe penetration holes ≤ 15 (380) are allowed in riser sections.

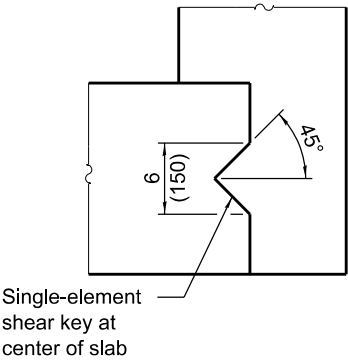

**SHEAR KEY GEOMETRY**  
(Reinforcement not shown for clarity)


**GENERAL NOTES**

- Pipe holes shall be formed to facilitate proper placement of hole reinforcement.
- The manufacturer shall ensure that all precast manhole sections are additionally reinforced where required to resist damage from handling, shipping and installation stresses.
- Lifting holes shall be located in the sections as per the manufacturer's recommendations.
- See Standard 602701 for details of manhole steps.
- All dimensions are in inches (millimeters) unless otherwise noted.



DATE	REVISIONS
1-1-21	Revised Note 1 and lifting hole general note.
3-1-19	Moved wall reinforcement from inside face to middle.

**PRECAST MANHOLE TYPE A**  
**9' (2.74 m) DIAMETER**  
(Sheet 1 of 3)


**STANDARD 602421-09**

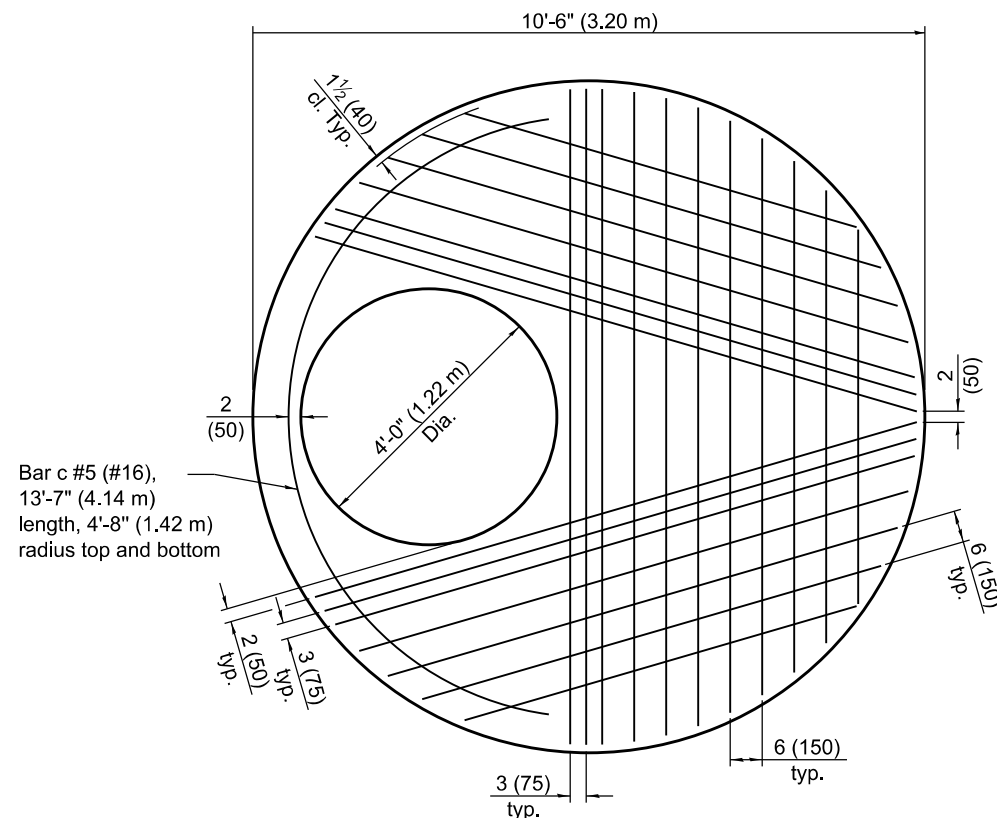

**PLAN - FLAT SLAB TOP**  
(Showing layout of bottom reinforcement bars and c bars)

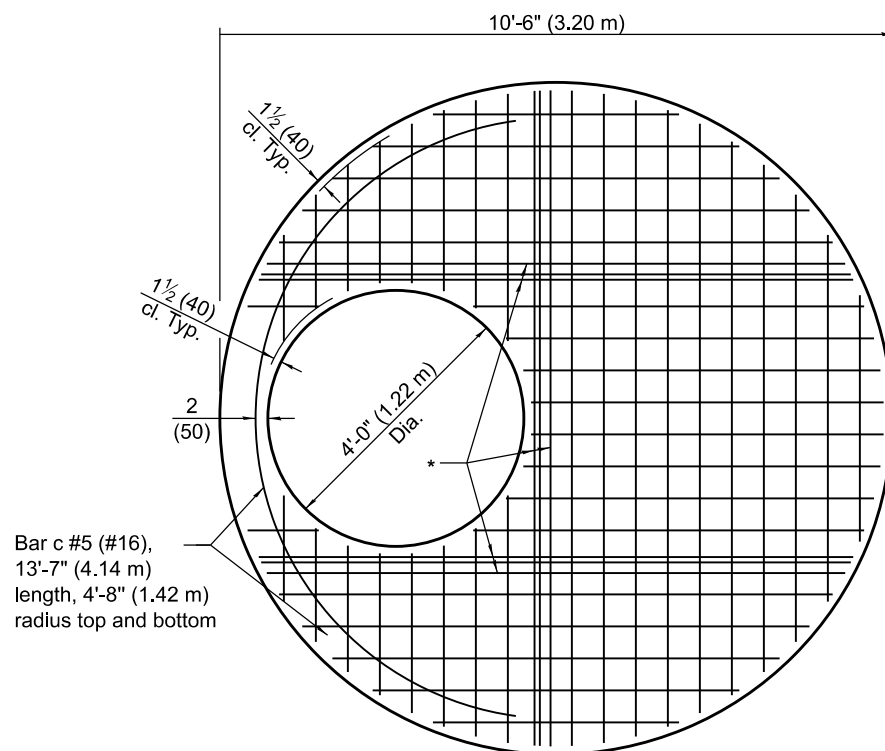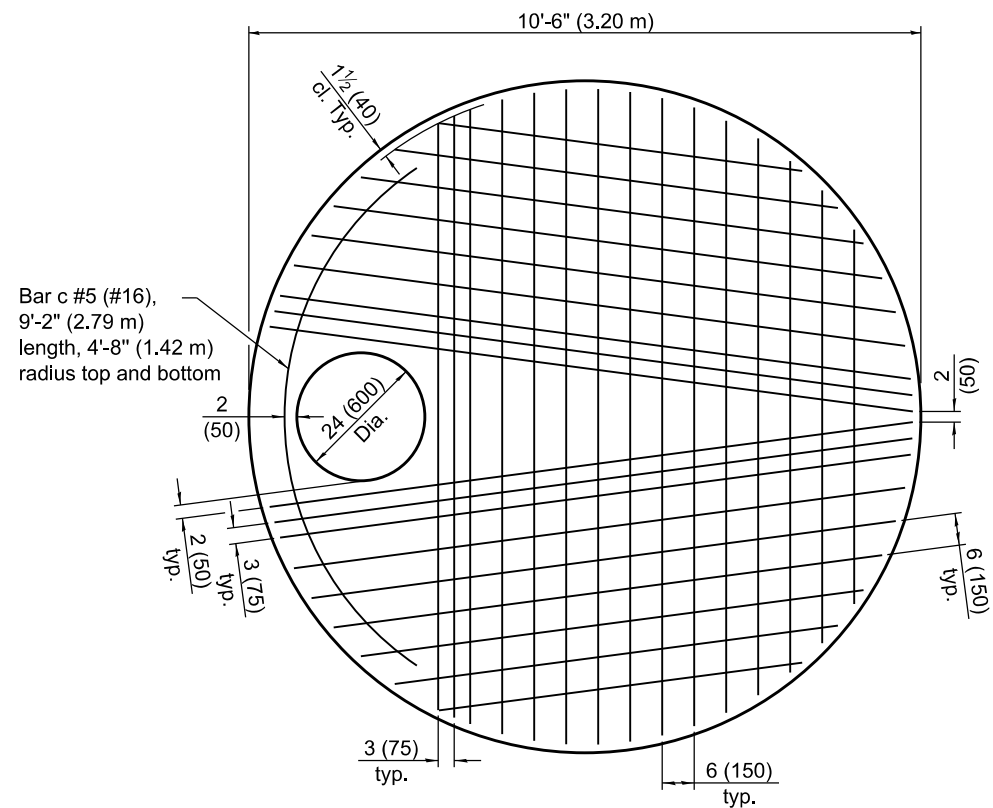

**PLAN - FLAT SLAB TOP**  
(Showing layout of welded wire reinforcement and c bars)  
WWR not permitted for riser heights > 10' (3.05 m).

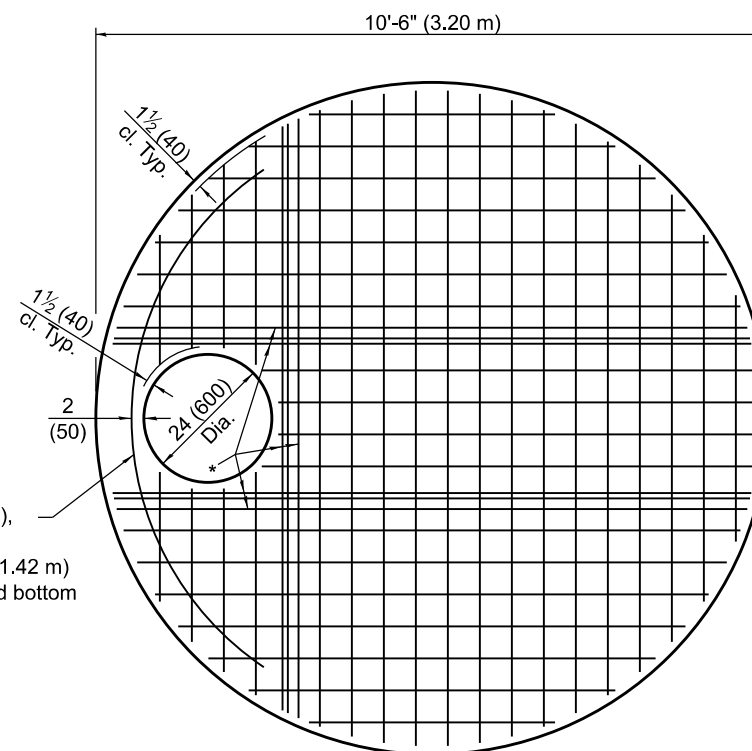

\* #6 (#19) bars bottom. Bundle first bar with closest WWR bar to the opening and place second bar ±3 (75) away.

## PRECAST MANHOLE TYPE A 9' (2.74 m) DIAMETER

(Sheet 2 of 3)

STANDARD 602421-09

