



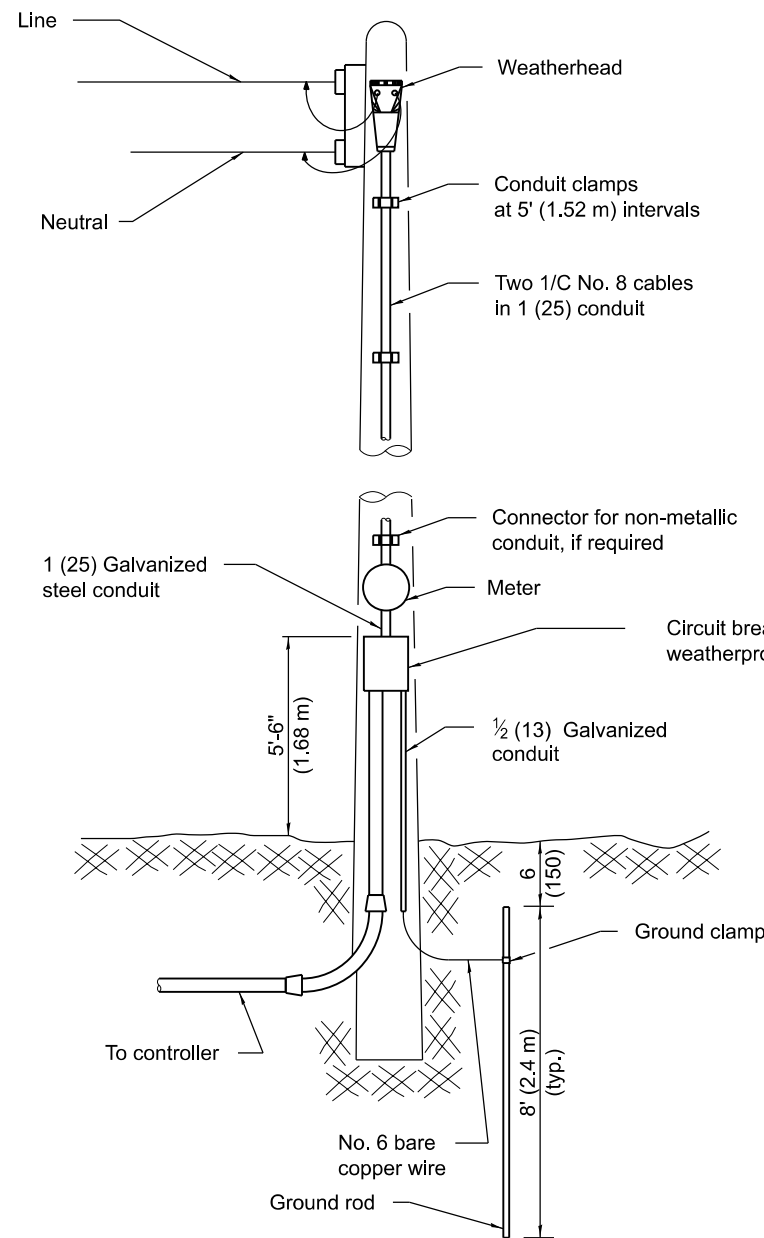


TYPE A

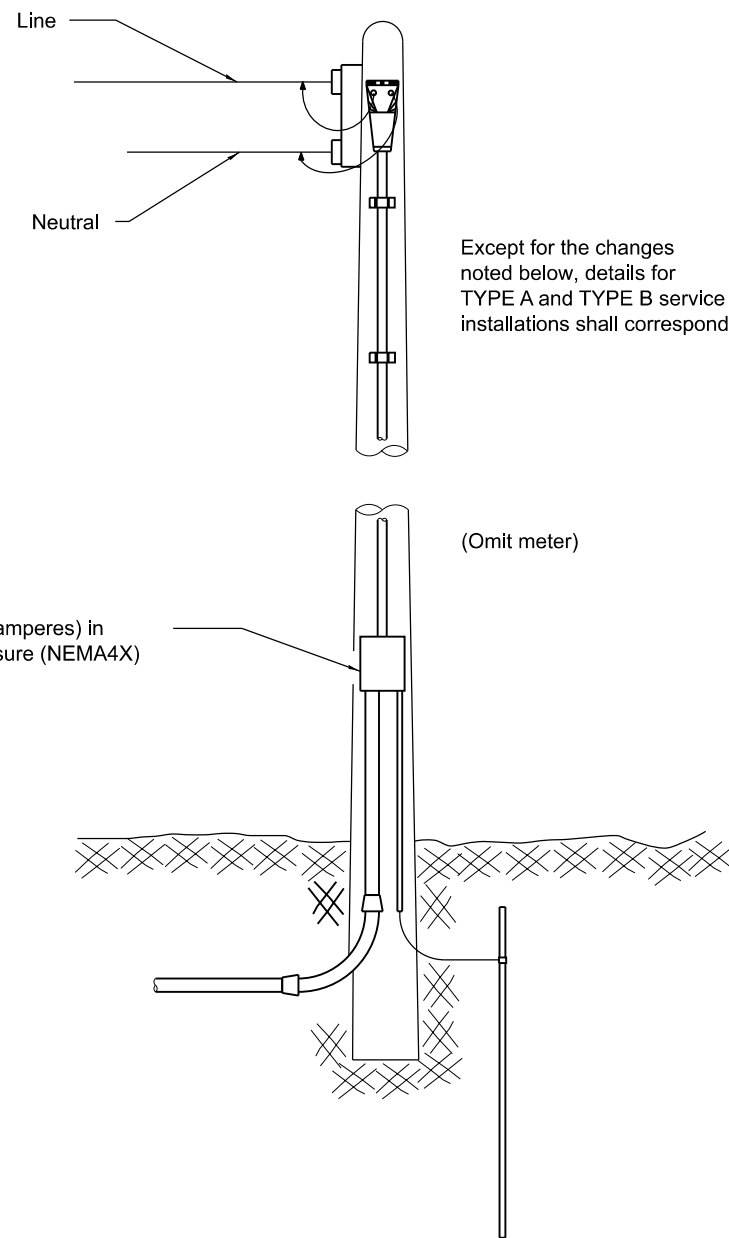

TYPE B

Except for the changes noted below, details for TYPE A and TYPE B service installations shall correspond.


(Omit meter)

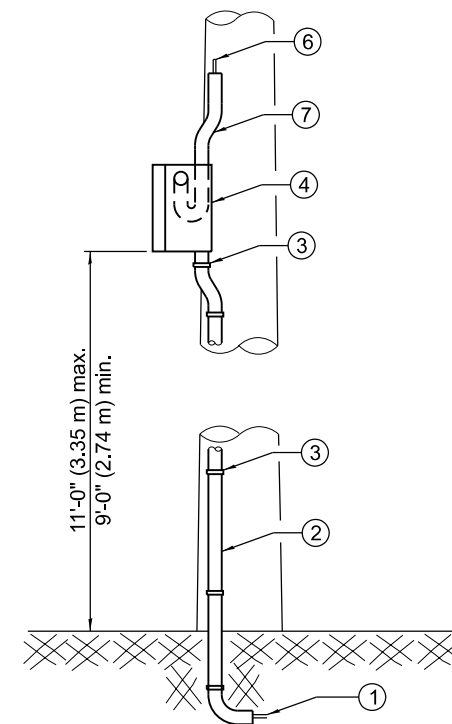

The following equipment is to be furnished and installed on the TYPE C installation.

- ① Cable in conduit (electric cable, No. 6, 2/C except where otherwise specified)
- ② Galvanized steel conduit 1 1/4 (32) with bend
- ③ Galvanized conduit clamps
- ④ Aluminum weatherproof box with gasketed cover. Weatherproof box shall be installed facing the adjacent property line. (See diagram for alternate installation.)
- ⑤ Ground stud for neutral connection
- ⑥ Service cables
- ⑦ Offset weatherproof fitting
- ⑧ Circuit breaker

TYPE C

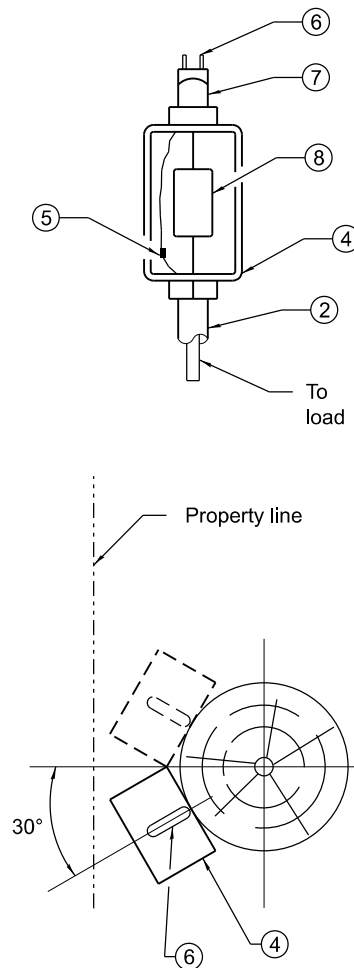

ALTERNATE INSTALLATION

(Installation when weatherproof box cannot be installed facing the adjacent property line.)

All dimensions are in inches (millimeters) unless otherwise shown.

Illinois Department of Transportation	
APPROVED _____ January 1, 2009 ENGINEER OF OPERATIONS	ISSUED 1-1-02
APPROVED _____ January 1, 2009 ENGINEER OF DESIGN AND ENVIRONMENT	

DATE	REVISIONS
1-1-09	Switched units to English (metric).
1-1-02	Renum. Standard 2373-1.

**ELECTRICAL SERVICE
INSTALLATION DETAILS**

STANDARD 805001-01